



- Application:

- Warehouse
- Stadiums
- Factories
- Supermarket
- Logistics Center
- Exhibition Hall



### Driver Housing

Black  
Blue driver housing colour optional

### Housing

2020 Patented design  
IP66  
Nano-thin design  
White/Blue optional

### LED driver

Built-in driver  
AC120-277V/AC120-347V/  
AC277-480V optional

### Lens

60°/120° optional

### Sensor Add-on Options

Built-in Infrared Sensor (optional) Not standard


## Parameters

Model #	Size	Power	Ultra High Lumen		Input voltage	Beam angle
			CRI	Lumen		
HBS4P60-XXK-YZ-X	Φ11.62''*5.4''	60W	>90	7800LM	AC120-277V	60°
HBS4P80-XXK-YZ-X		80W	>70	12000LM		
HBS4P100-XXK-YZ-X		100W		15000LM		
XSY-HBS4P150-50K-LV-120		150W		22500LM	AC120-347V	120°
HBS4P200-XXK-YZ-X	Φ12.95''*6.7''	200W	>70	30000LM	AC277-480V	60° 120°
HBS4P250-XXK-YZ-X		250W		37500LM		
HBS4P100-HV-XXK-YZ-X	Φ11.62''*7.3''	100W		15000LM		
HBS4P150-HV-XXK-YZ-X		150W		22500LM		
HBS4P250-HV-XXK-YZ-X	Φ12.95''*8.06''	250W		37500LM		

# Ordering Guide


Brand	Product name	Power	Input voltage	CCT	Beam angle	Sensor	Lighting efficacy
ELS	HBS4	P100	HV	XXK	Y	Z	X
ELS CAN	HBS4	60W	Blank AC120-277V/ 120-347V	40K 4000K	60 60° 120 120°	S With D Without	A 150LM/W
		80W		50K 5000K			
		100W	HV AC120-347V	5000k			22500LUMENS
		150W					
		200W					
		250W					

# Dimension

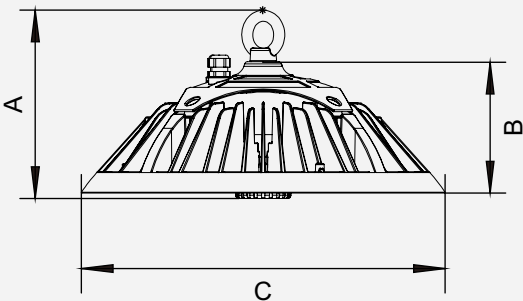

AC120-277V/AC120-347V

Power \ Size	A	B	C
60w/80w/100w/150w	5.4''	3.54''	Φ11.62''
200W/250w	6.51''	4.65''	Φ12.95''

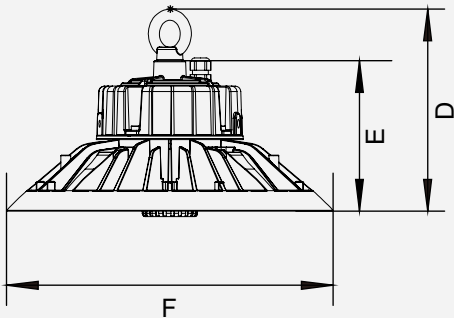


AC277-480V


Power \ Size	D	E	F
100W/150W	7. 20''	5. 36''	Φ11.62''
250w	7. 87''	6. 04''	Φ12.95''

# Installation


**ALWAYS TURN OFF THE POWER SUPPLY FROM MAIN CIRCUIT BREAKER FIRST!**

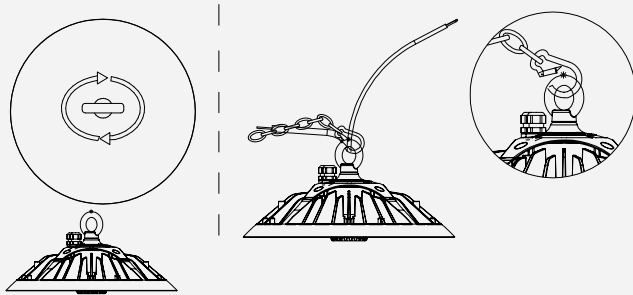


**Diagram1:** Fix the hook on the light. (clockwise rotation). link up the hook and Carabiner.

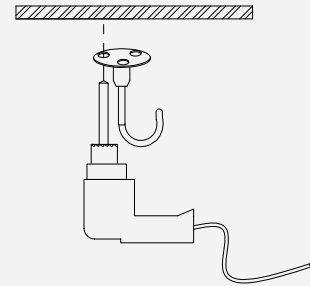

**Diagram2:** Use electric drill to bore a hole on the wall.

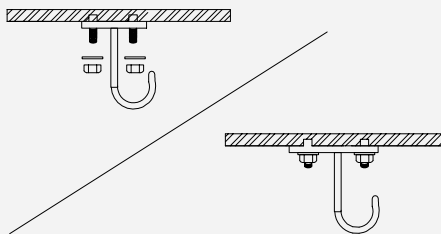


**Diagram3:** Fix the hanger on the wall with screws.

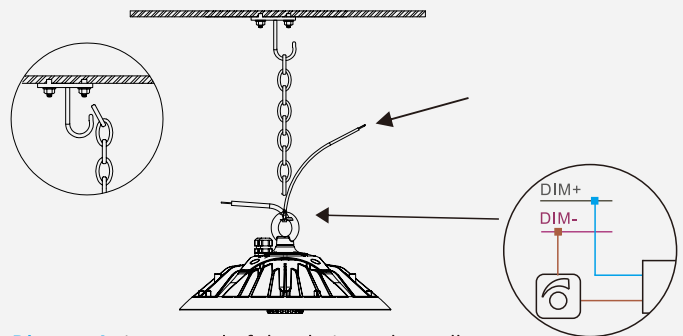


**Diagram4:** Fix one end of the chain to the wall, another end to the O hook from light, finish the installation.

Dimmer connect the wires:  
DMI+ match DMI+;  
DMI+ match DMI+

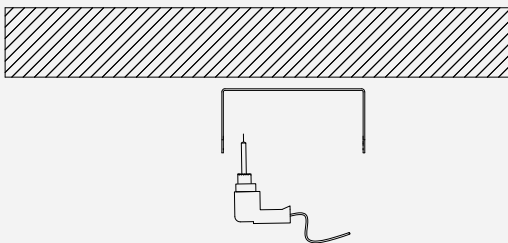


**Diagram1:** Use electric drill to bore a hole on the wall.

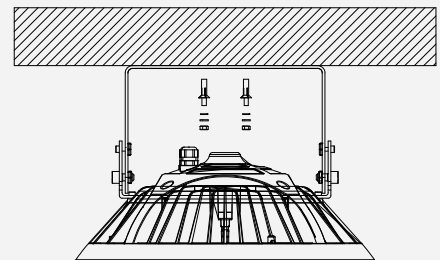


**Diagram2**

Set the expansion screws into the existing pre drilled holes

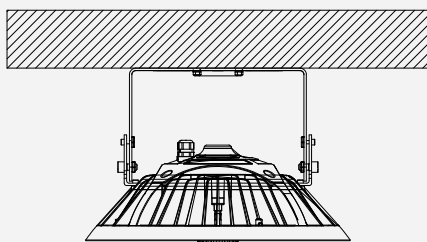

**Diagram3:** Fix the U bracket to the wall by nut, plain. cushion, Spring shim

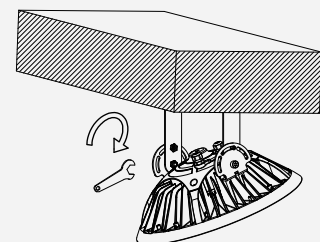

**Diagram4:** Use wrench to reverse hexagon nut to adjust to correspondng angle at installers discretion.

# Package Info.

Stock Availability

Model	Carton Dimension	Qty / Carton	N.W	G.W	20GP	40HQ
60W/80W/100W/150W (AC120-347V)	13.4''*13.4''*5.5''	1PCS	6.6lbs	8.38lbs	1518pcs	4177pcs
200W/250W (AC120-347V)	15''*15''*6.3''	1PCS	10.14lbs	12.15lbs	1090pcs	3000pcs
100W/150W (AC277-480V)	13.4''*13.4''*8.3''	1PCS	10.10lbs	11.99lbs	895pcs	2462pcs
250W (AC277-480V)	15''*15''*8.7''	1PCS	14.48lbs	16.25lbs	615pcs	1692pcs

## Safety Precaution

To reduce the risk of death, personal injury or property damage from fire, electric shock, falling parts, cuts/abrasions, and other hazards read all warnings and instructions included with and on the fixture box and all fixture labels.

Before installing, servicing, or performing routine maintenance upon this equipment, follow these general precautions. Commercial installation, service and maintenance of luminaires should be performed by a qualified licensed electrician.

For The installation: If you are unsure about the installation or maintenance of the luminaires, consult a qualified licensed electrician and check your local electrical code.

To prevent wiring damage or abrasion, do not expose wiring to edges of sheet metal or other sharp objects.

Do not make or alter any open holes in an enclosure of wiring or electrical components during kit installation.

**WARNING: RISK OF FIRE OR ELECTRICAL SHOCK**

Turn off electrical power at fuse or circuit breaker box before wiring fixture to the power supply.

Turn off the power when you perform any maintenance.

Verify that supply voltage is correct by comparing it with the luminaire label information.

Make all electrical and grounded connections in accordance with the National Electrical Code and any applicable local code requirements.

All wiring connections should be capped with UL approved wire connectors.

**CAUTION: RISK OF INJURY**

Avoid direct eye exposure to the light source while it is on.

Account for small parts and destroy packing material, as these may be hazardous to children.